




2151 South 54th Street  
West Allis Wi. 53219


Office: (414) 764-6733 Fax: (414) 764-1494

# Gate Valve Adaptor Detail Detail Specification

## GATE VALVE ADAPTOR

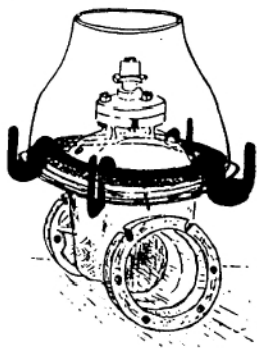


Gate Valve Adaptor  
Installed On A Valve  
With Box.



1/4" Steel With UV  
Polyurethane Protective  
Coating.

3/4" Rubber Gasket Attached To  
The Gate Valve Adaptor

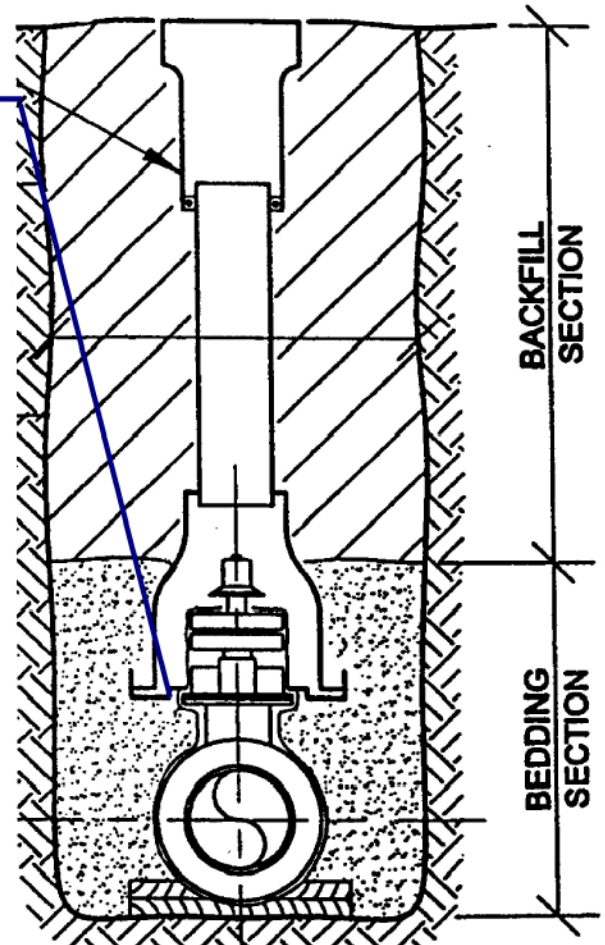

### Gate Valve Adaptor Spec

All valve boxes shall be installed upon the valve with the use of a Gate Valve Adaptor as manufactured by Adaptor Inc. or an approved equal. The adaptor shall be installed in lieu of hardwood blocking and shall be incidental to the valve and box installation.

Gate Valve Adaptor shall be 1/4" steel with a UV Polyurethane protective coating and a 3/4" rubber gasket attached to the Gate Valve Adaptor.